

Online Temperature Control System

A. Ikhlef¹, M. Kihel², B. Boukhezzar¹, A. Guerrouj¹, N. Mansouri¹

¹Laboratoire d'Automatique et de Robotique, Université Constantine 1, Constantine, Algérie

²Laboratoire Micro-systèmes et Instrumentation, Université Constantine 1, Constantine, Algérie

ameikhlef@yahoo.fr, kihel_mouloud@hotmail.com, b_boukhezzar@hotmail.com, abdou.guerroudj@yahoo.fr,
nor_mansouri@yahoo.fr

Abstract—In this paper, a remote temperature control system has been proposed. The physical system is controlled in real time through the Internet network. For educational purpose, the students use only a web browser to tune and test a PID controller via shared user interface. The PID parameters are calculated using the basic experimental Ziegler—Nichols tuning rules. After hardware and software experiment description, the remote online experiment is tested and the results are given.

Keywords—remote laboratories; electrical engineering; temperature system; PID controller; online learning.

I. INTRODUCTION

The great success of the Internet put new life into distance learning. Recently, many institutions propose internet-based courses and e-learning educational programs. E-learning and internet-based tools and methodologies is also an active research field.

Experiments are an important part of educational programs, particularly in engineering and experimental sciences such as physics and chemistry. However, the high cost and/or complexity of the experiments prevent the students to work in the suitable conditions. In the case, the remote laboratories seem to be the best solution. The main aim of these laboratories is to share the same experimental equipment between an important numbers of users, spread in a given geographical area. Moreover, they give a remote access to hardware experiments without the necessity of people displacement. Furthermore, other benefits are obtained by saving time and reducing inactivity days.

Remote labs capitalize the large diffusion of the Internet over the world. Essentially, they exploit web-based platforms to give an interactive interface to the users. This interface interacts directly with the remote hardware via requests-answers sent on the network. Many architectures and platforms are used to achieve these objectives. From the user's side, only a simple web browser (Internet Explorer, Mozilla Firefox) with generally an appropriate plug-in is necessary (JRE for applets based interfaces, runtime engine for a LabVIEW based remote experiments).

In the domain of electrical engineering, many remote experiments and online laboratories have been designed [1-4]. Some of them deal with fundamental electronics experiments.

The aim of this paper is to present the design details and test process of an online remote temperature system control

experiment. Beyond its classical aspect, this choice is motivated by the fact that the physical system is simple but relevant. Both identification and online PID controller design are included in the remote experiment.

This paper is organized as follow: Section II presents the used hardware and the software environment. In section III, the objectives, technical content and procedure of the remote experiment are presented. This is done either from the experiment designers or administrators side or from the remote-student side. The remote experiment test is presented in section IV. Finally, conclusions and some perspectives are given.

II. EXPERIMENT DESCRIPTION

The work described in this paper was performed within the framework of the Tempus e-science project (Euro-maghribien project financed by the European community) where the university Constantine1 is a partner. The main objective of this project is the use of new technologies in order to develop e-learning in the electrical engineering field, especially the implementation of remote labs, for experimental works.

A. Hardware Part

In this part, the design of an interactive network structure is represented. This structure allows students to supervise and control the temperature in an experimental system using a PID controller. This architecture allows the students to change the desired temperature value and the PID controller parameters

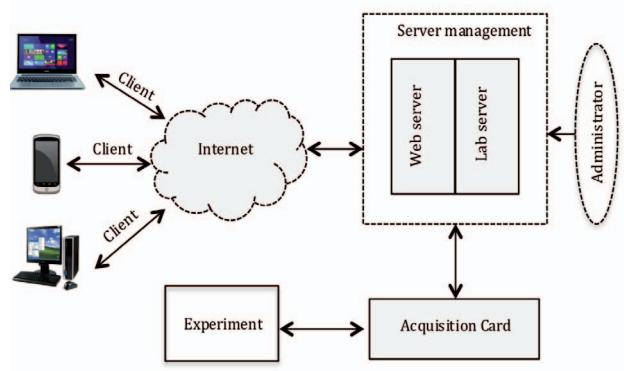


Fig 1. Online lab architecture

during the experiment from any terminal connected to the Intranet or Internet network. Different kinds of network architectures can be used for an ilab [5]. The proposed network architecture is represented in Fig. 1 and the system used for this experiment is shown in Fig. 2. It is composed of a temperature measurement system, an acquisition card and a server. All these parts are connected together according to the control loop given in Fig. 3. The block diagram shows a closed loop control system. The measured temperature is compared with a reference value. The difference between these two values is processed by a PID controller, which will initiate actions to drive the difference signal toward zero. The supervision and the control of the system output are performed through a graphical user interface (GUI) developed in the Lab server.

B. Software Part

As indicated in the above section, the acquisition card used in this work is a NI-6008 card, which is compatible with the LabVIEW development environment [6]. Therefore, this environment is used for data-acquisition, remote monitoring, and control of different experiment parameters via a GUI.

We notice that, the LabVIEW environment can control experiments connected to the Intranet or the Internet network in real time using LabVIEW webserver. It also offers the

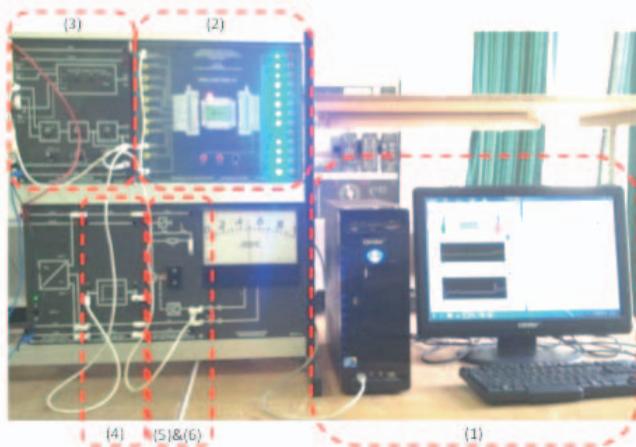


Fig 2. Online lab architecture

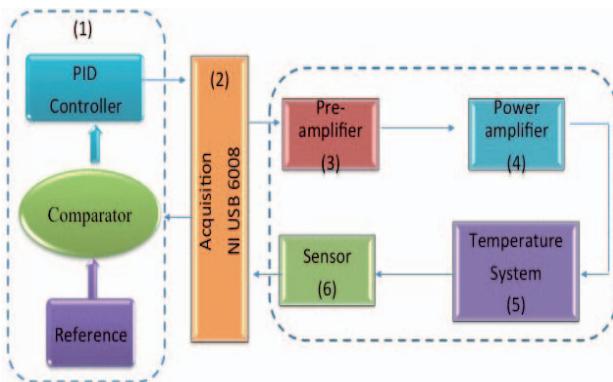


Fig 3.Experiment block diagram

possibility to control experiments remotely from a web browser. In this case, the only required software for the remote clients is LabVIEW Runtime Engine (can be downloaded freely from National Instruments website).

As exhibited in Fig. 1, this environment has a lab server that manages the experiment and a web server that handles client access. Real time remote monitoring and control is effectuated by using the LabVIEW web-publishing tool. In this case, the developed VI (Virtual instrument) is accessible on the local or the Internet network via web browsers. In order to access the VI remotely, the IP address of the server and the name of the shared VI should be known by the remote client. At the same time, the published VI must be always running on the Lab server. The remote user regains the control of the experiment only after requesting and receiving acceptance from the server. During the experiment, the students can start and stop the program execution whenever they want. They can change at any time, the desired temperature value and the PID controller parameters. Moreover, it is also possible to store all the experiment results data from the graph in "spreadsheet" format.

III. TEMPERATURE CONTROL REMOTE EXPERIMENT

The temperature subsystem is involved in many everyday life systems such as air conditioning units, irons, electric ovens and many other industrial systems [7]. The proposed remote experiment concerns temperature system control. The heat is generated by a thermal resistance.

A. Remote Experiment Objectives

The aim of the experiment can be summarized in three objectives which constitute the student work steps:

- Temperature system identification from experimental data.
- Open-loop Ziegler-Nichols PID tuning and test on the temperature system.
- Closed-loop Ziegler-Nichols PID tuning and test on the temperature system.

B. Preparing the Practical Work

Before the physical remote experiment, the students are provided with experimental data obtained from a step response of the temperature system. The students are asked to plot the system time answer and to confirm its S-shape. The expected curve is shown in fig. 4.

Once the curve obtained and plotted, they should identify the parameters of a first-order delayed system: static gain K , time constant τ and delay τ_d . The transfer function of the model is of the following form [8]:

$$G(s) = \frac{Ke^{-s\tau_d}}{1+s\tau} \quad (1)$$

C. Remote Experiment Content

As the experimental objectives, the experiment content can be divided into two parts: Open-loop and closed-loop PID tuning and test.

- 1) Open-loopZiegler-Nichols PID tuning and test:

Once the experimental model obtained during the student preparation, a PID controller is directly obtained using Ziegler-Nichols rule for open-loop identified system [8]. The parameters K_p , T_i and T_d are a function of the answer curve slope a and the model delay τ_d .

From the users side, the remote students have an interface to introduce directly the PID parameters and to make a real remote test on the physical system via a web browser. This interface allows the students to follow in real time the regulated physical system response on the web browser. The student has to do an analysis work to adjust the true parameters if a wrong result is obtained as saturation or overshoot.

The student interface is shown in Fig 5. For both open and closed loop case, the implemented controller on the measurement server using LabVIEW has the following transfer function

$$C(s) = K_p \left(1 + \frac{1}{T_{is}s} + T_d s \right) \quad (2)$$

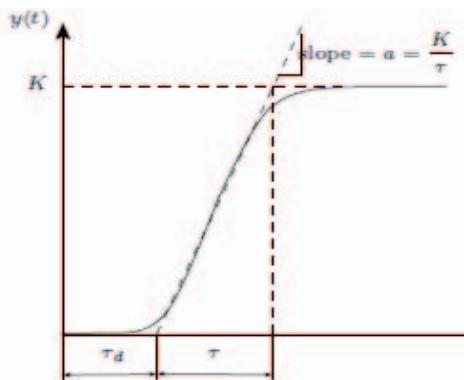


Fig. 4. Open-loop answer of a delayed first order system

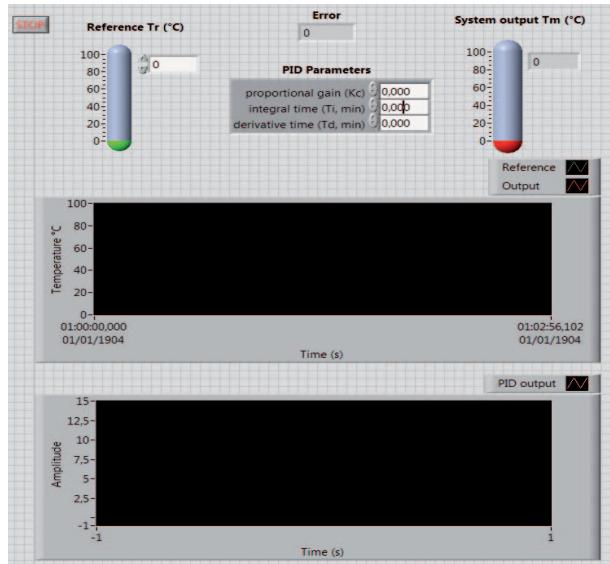


Fig. 5. Student interface to tune the PID controller.

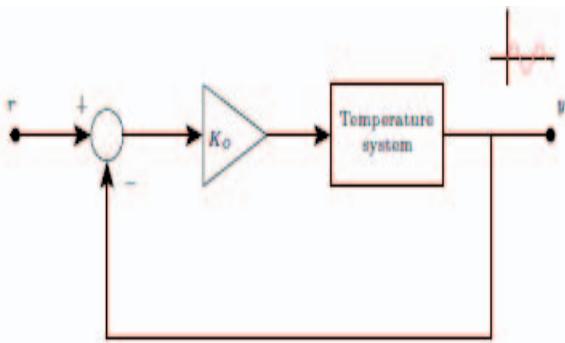


Fig. 6. Oscillating closed-loop answer with proportional action.

2) Closed losed-loop Ziegler-Nichols PID tuning and test:

For the closed loop case, the process to be controlled is put in a closed loop with a variable gain K_o . As shown in Fig 6, the gain is tuned until the system starts to oscillate. The value of K_o causing the start of oscillation and the oscillations period T_o are then used to tune the three PID parameters [8].

IV. EXPERIMENT RESULTS

In order to illustrate the performance of the experimental lab described in this paper, the effect results of different PID parameters on the system response have been investigated.

Fig. 7 and Fig. 8 represent the temperature system responses when the PID parameters are tuned from the Zeigler Nichols open loop (ZNOL) and closed loop (ZNCL) methods, respectively. The interface that controls the system via a web browser is shown in Fig. 9.

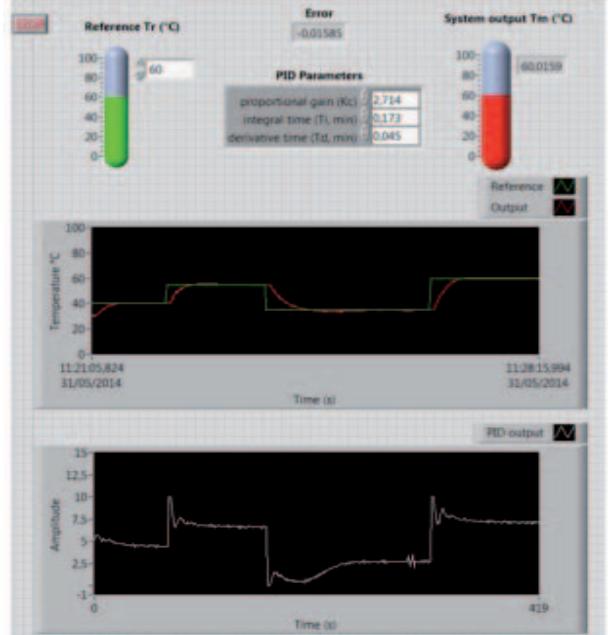


Fig. 7. Temperature system response with PID parameters tuned from ZNOL.

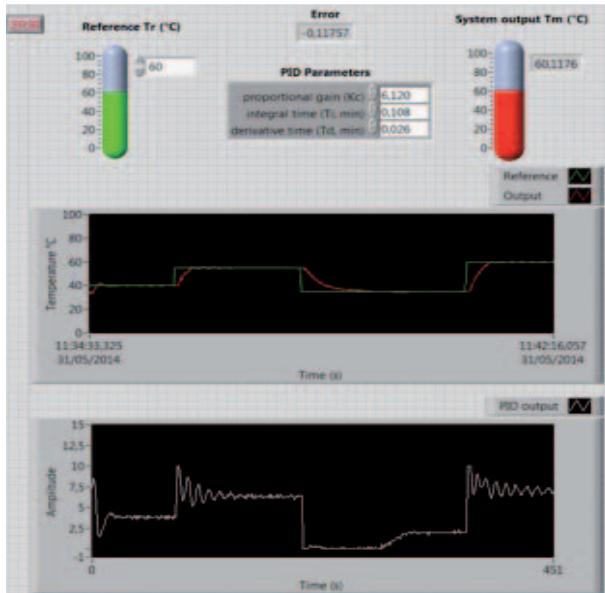


Fig. 8. Temperaturesystem responsewith PID parameterstuned from ZNCL

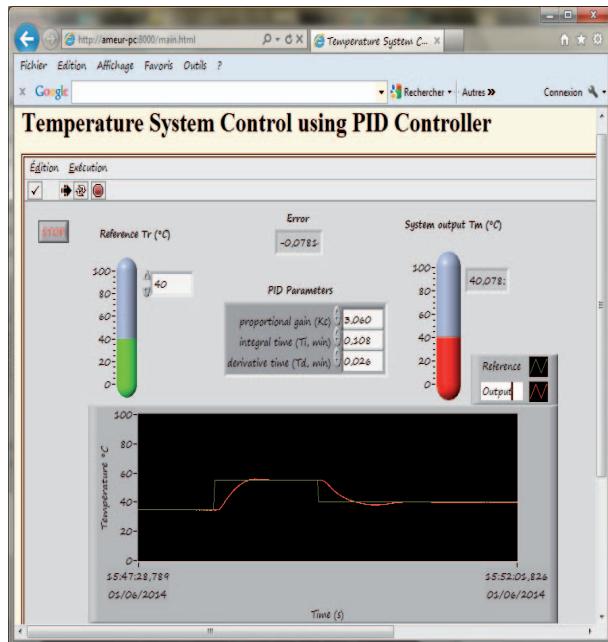


Fig. 9. Graphical user interface as displayed on remoteclient web browser.

V. CONCLUSION

An online remote temperature control system is proposed for educational purpose. A simple web browser is used by the students to access to the physical experiment. Experimental Ziegler-Nichols tuning rules for a PID controller are tested in real time. The control system has been successfully tested online. As a perspective, an ilab shared architecture (ISA) will be used to share the experiment on the Internet network.

ACKNOWLEDGMENT

This project has been funded with support from the European Commission. This publication reflects the views only of the author, and the Commission cannot be held responsible for any use which may be made of the information contained therein.

REFERENCES

- [1] T. A. Fjeldly and M. S. Shur, LAB ON THE WEB Running Real Electronics Experiments via the Internet. Wiley-interscience, 2003.
- [2] A. Leva and F. Donida, "A remote laboratory on PID autotuning," Proc. 17th IFAC World Congress. Korea, pp. 8147-8152, July 2008.
- [3] B. Aktan, C.A. Bohus, L.A. Crowl, and M.H. Shor, "Distance learning applied to control engineering laboratories," IEEE Transactions on Education, Vol. 39, pp. 320-326, 1996.
- [4] P. H. Wu and C. H. Kho, "The design and implementation of a remote automatic control laboratory: using PID control as an example," Tamkang Journal of Science and Engineering, Vol. 11, pp. 219-228, 2008.
- [5] V. Judson et al, "The ilab shared architecture: a web services infrastructure to build communities of internet accessible laboratories," Proceeding of IEEE, Vol. 96, No. 6, pp. 930-951, June 2008.
- [6] LabVIEW software platform, URL: <http://www.ni.com/labview>.
- [7] P. Zhang, Advanced Industrial Control Technology. 2010.
- [8] G. F. Franklin, D. J. Powell, and A. Emami-Naeini, Feedback Control of Dynamic Systems. Prentice Hall, 2002